



**Montageanleitung Winddrucksicherung  
für die e<sup>2</sup> Serie 9/WDSE  
assembly instructions wind pressure protection  
for the series e<sup>2</sup> 9/WDSE  
Best.-Nr. / Order No. 39860**

**Sicherheitshinweis**

**DE**



**Vorsicht!** Jede Montagearbeit am Lüftungsgerät darf nur bei abgetrennter Netzspannung erfolgen!

**Hinweise**

**DE**


Minimal benötigte Rohrlänge:

- e<sup>2</sup> / e<sup>2</sup>60: 370 mm
- e<sup>2</sup>short / e<sup>2</sup>60short: 290 mm


**Montage**

**DE**

Montagesteg der Winddrucksicherung in die Aussparungen\* im Gehäuse des Lüftereinsatzes einpressen.

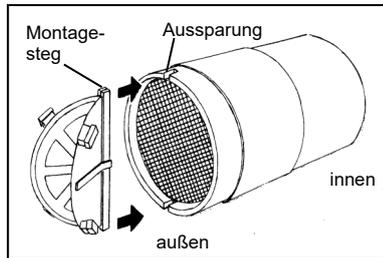

Lüftereinsatz in das Montagerohr einschieben, Montagesteg der Winddrucksicherung dabei senkrecht positionieren, Spannungsversorgung anschließen, Innenblende mit Filterrahmen aufsetzen.

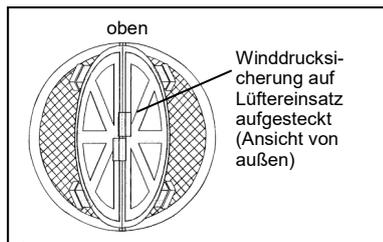

**Safety instructions**

EN



Caution! Any assembly work on the ventilation unit may only be carried out when the mains voltage is disconnected!

**Note**

EN


Minimum pipe length required:

- e<sup>2</sup> / e<sup>2</sup>60: 370 mm
- e<sup>2</sup>short / e<sup>2</sup>60short: 290 mm


**Installation**

EN

Press the installation bar of the wind pressure protection into the recesses\* in the housing of the fan insert.

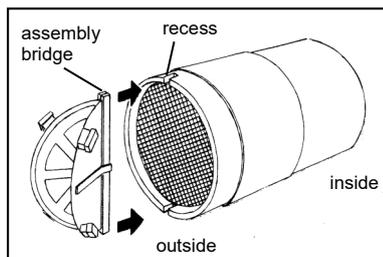

Slide the fan insert into the mounting tube, positioning the mounting bar of the wind pressure protection vertically, connect the power supply, put on the inner cover with the filter frame.

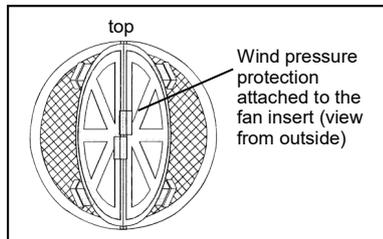

LUNOS Deutschland  
LUNOS Lüftungstechnik GmbH & Co. KG  
für Raumluftsysteme  
Wilhelmstr. 31  
13593 Berlin · Deutschland

Tel. +49 30 362 001-0  
Fax +49 30 362 001-89  
info@lunos.de  
www.lunos.de

E130 12.22